



Certificate of Analysis

Test Report | 27Aug2026-08

Date of report	August 24, 2026	Certificate ID	27Aug2026-08
To	Redacted	From	AxisPharm, LLC
Sample received	08/26/2026	Receiving condition	Acceptable
Storage condition	Room temperature	Results reported by	Archer Liu

Sample details


Sample Name: TRIPLE BIO REGULATOR; Brand Name: Redacted ; Lot#: RETA-10-201-26; MFD: 07/2026; BBD: 07/2028

Method(s): LCMS

Results

Sample Name	Net Weight Measured (mg)	MW (g/mol)	Detected	UV Purity (%)
TRIPLE BIO REGULATOR	9.1	4731.33	2367.4[M+2H]/1578.9[M+3H]	98.2%

Analytical data

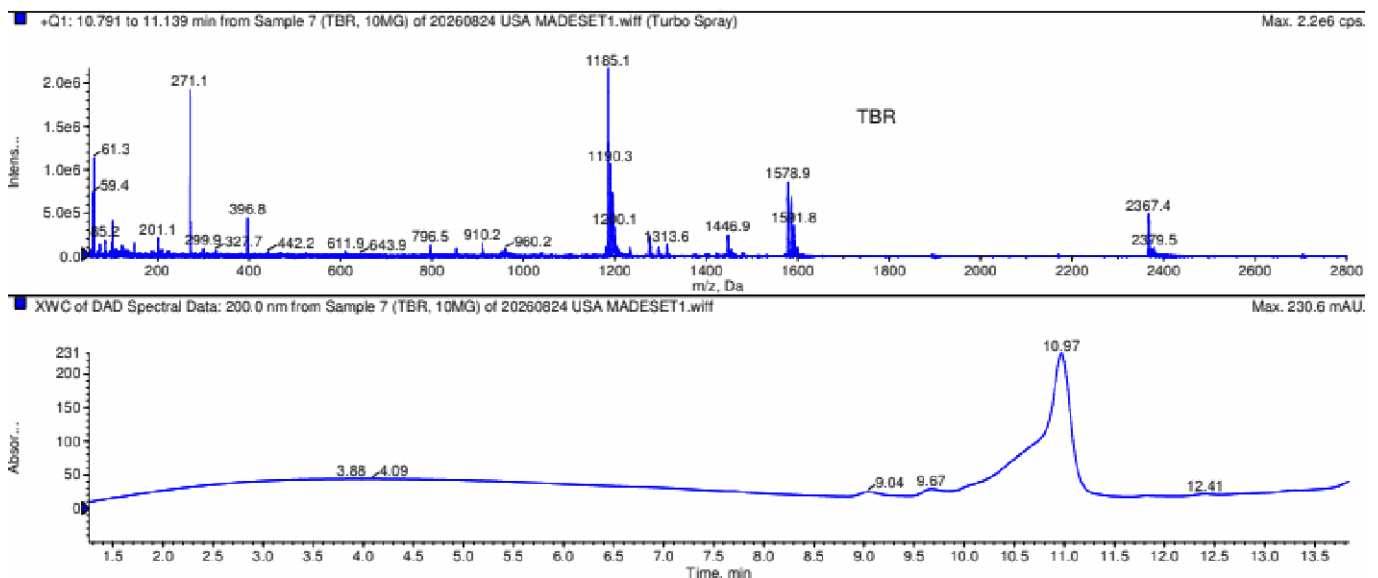

Salts and sugars that serves as fillers in injectables/nasal sprays/oral stripes are not considered as impurities.
Conclusion: The samples comes with TRIPLE BIO REGULATOR, 9.1mg and with purity of 98.2% by UV.

Review/Approved by: Dawei Yue | QA Director

Results only apply to tested Research Use Only samples within Test Report as received. Not for use in humans or animals. Analytical data apply only to the batch tested and do not indicate suitability for diagnostic or therapeutic use. Any unauthorized alteration, reproduction, or relabeling of this COA renders it invalid.